



TGC REPORT NO: 807231  
DATE: AUGUST 8, 2018

**GEOTECHNICAL STUDY  
PROPOSED IVY KIDS  
ON C.R. 94 NEAR C.R. 101  
MANVEL, TEXAS**

PREPARED FOR:  
LONE STAR ACADEMICS AND CHILDCARE,  
LLC  
2008 BISCAYNE LAKE DRIVE  
PEARLAND, TEXAS 77584



TEXAS GEOTECHNICAL CONSULTANTS, LLC  
HOUSTON, TEXAS

# TEXAS GEOTECHNICAL CONSULTANTS, LLC

Geotechnical

Environmental

Materials Testing

Date: August 8, 2018

Job No: 807231

Lone Star Academics and Childcare, LLC  
2008 Biscayne Lake Drive  
Pearland, Texas 77584

Attention: Mr. Thomas Koshy

Reference: Geotechnical Study  
Proposed Ivy Kids  
On County Road 94 near County Road 101  
Manvel, Texas

Dear Mr. Koshy:

Texas Geotechnical Consultants, LLC (TGC), is pleased to submit this report for the geotechnical investigation at the above referenced location. Our findings, analysis and recommendations are submitted herein.

It has been a pleasure working with you on this project and look forward to working with you on your future projects. Should you have any questions regarding this report, please call us at (281) 407-6335.


**TEXAS GEOTECHNICAL CONSULTANTS, LLC.**

TBPE FIRM NO. F-14495



Jay Vaghela, MSCE, P.E.

Project Manager

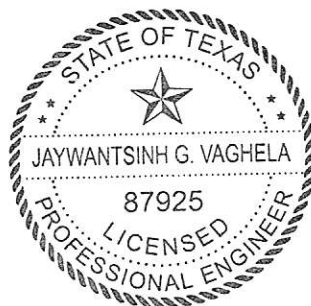

## TABLE OF CONTENTS

<u>DESCRIPTION</u>	<u>PAGE</u>
1.0 INTRODUCTION.....	1
2.0 PROJECT SCOPE.....	1
3.0 SITE CONDITIONS.....	2
4.0 FIELD EXPLORATION.....	2
5.0 LABORATORY TESTING.....	3
6.0 SOIL STRATIGRAPHY.....	3
7.0 GROUNDWATER INFORMATION.....	5
8.0 POTENTIAL VERTICAL RISE.....	6
9.0 FOUNDATION RECOMMENDATIONS.....	8
9.1 DRILLED PIERS.....	8
9.1.1 FLOOR SLABS SUPPORTED ON DRILLED PIERS.....	10
9.2 FLOATING SLAB FOUNDATIONS.....	11
9.3 FOUNDATION SETTLEMENT.....	11
10.0 PAVEMENT.....	12
10.1 GENERAL.....	12
10.2 CONCRETE PAVEMENT.....	12
10.3 ASPHALT PAVEMENT.....	13
11.0 SITE PREPARATION.....	14
12.0 VEGETATION CONTROL.....	15
12.1 EXISTING TREES.....	15
12.2 NEW TREES.....	15
13.0 SITE DRAINAGE.....	16
14.0 CONSTRUCTION OBSERVATIONS.....	17
15.0 LIMITATIONS OF STUDY.....	17
16.0 REFERENCES.....	18

LIST OF PLATES

PLATE 1	PLAN OF BORING LOCATIONS
PLATES 2-6	LOG OF BORINGS
PLATE 7	KEY TO LOG TERMS AND SYMBOL

## 1.0 INTRODUCTION

This investigation was authorized by Mr. Thomas Koshy of Lone Star Academics and Childcare, LLC, with the acceptance of TGC Proposal No. GP18-0546 dated May 24, 2018. Project details were provided to TGC by Mr. Koshy. It is planned to build a new Ivy Kids facility on County Road 94 near County Road 101 in Manvel, Texas. It is planned to build a 16,000 square feet one story building. There will be associated parking and drives. Although the building column or wall loading information is not currently known to us, it is anticipated that the maximum column loads will be less than 100 kips and the maximum wall loads will be less than 2 kips/feet. This report includes results of the field investigation, laboratory testing, geotechnical engineering analysis and recommendations for the design and construction of proposed building, parking and drives.

## 2.0 PROJECT SCOPE

The purpose of this geotechnical investigation was to explore the subsurface and ground water conditions at the site, perform laboratory tests on the sampled soils and develop geotechnical engineering recommendations for the design and construction of the proposed new building and parking and drives.

Our scope of services included the following:

- Drilling three (3) soil borings to a depth of 20 feet each for the building and two (2) soil borings to a depth of 5 feet each for the parking and drives.
- Observation of ground water conditions in the borings at the time of drilling.
- Obtaining samples at select depths for performing laboratory tests.
- Performing select laboratory tests on selected soil samples for determining the soils moisture, strength and expansion potential.
- Develop a log of borings by incorporating the field and laboratory data.
- Performing geotechnical engineering analysis and developing foundation design and construction recommendations for the project.

Our scope of work did not include any chemical testing or environmental sampling of the soils. Any information regarding odors in soil samples, soil colors, textures, etc., on the logs of borings or in the report are given for informational purposes only. A geologic fault study to evaluate the potential of surface faulting at this site was also beyond the scope of this study.

### 3.0 SITE CONDITIONS

The site is relatively flat with a topographic variation of less than 3 feet. The site drainage appears to be fair. The project site is currently vacant and covered with grass.

### 4.0 FIELD EXPLORATION

At the request of the client, the soil conditions were explored by three (3) soil borings drilled to a completion depth of twenty (20) feet each for the building and two (2) soil borings drilled to a completion depth of five (5) feet each for the parking and drives. Boring locations as drilled for this geotechnical exploration are approximately shown on Plate 1. Undisturbed samples were obtained continuously at the boring location to a depth of ten (10) feet and then at five (5) feet intervals thereafter.

Dry auger drilling methods were generally adopted to drill the soil borings to more accurately observe the depth of groundwater. In cohesive soils, undisturbed soil samples were collected using a conventional 3-inch O.D. Shelby tube in general accordance with ASTM D1587. Cohesionless soils were sampled using split spoon sampler in general accordance with ASTM D1586. Standard penetration test (SPT) were performed in the granular soils. All soil samples were examined, classified and logged in the field. Cohesive soil strengths were estimated in the field using a hand penetrometer.

## 5.0 LABORATORY TESTING

In addition to the field exploration, supplemental laboratory testing was performed to verify field information and obtain additional pertinent engineering characteristics of the soils. Samples obtained from the field were again examined and classified in the lab. Additional testing was performed on selected samples to determine the moisture, shear strength, sieve 200 and atterberg limits of the soils. The results of laboratory tests are presented on the borings logs in Plates 2 through 6 of this report.

Soil samples obtained during testing will be stored for a period of 14 calendar days subsequent to the submittal of this report. Unless requested otherwise in writing, the soil samples will be discarded.

## 6.0 SOIL STRATIGRAPHY

Based on the soil boring and the results of the field and laboratory test data, a generalized soil profile is presented below.

**Table 1: Generalized Soil Profile**

<i>Stratum No.</i>	<i>Starting Depth, feet</i>	<i>Ending Depth, feet</i>	<i>Soil Description</i>
I	0	2	Possible Fill: Fat Clay (CH), hard, dark gray and brown, with calcareous nodules, sand pockets and root organics; in boring B-3.
II	0 - 2	4	Possible Fill: Lean Clay (CL), hard, dark gray, brown and reddish brown, with calcareous nodules and sand pockets and root organics.
III	4	13	Lean Clay (CL), stiff to hard, tan and brown, with ferrous and calcareous nodules.
IV	13	20	Silty Sand (SM), medium dense, tan and brown, with clay pockets, moist to wet.

It should be noted that it is often difficult to distinguish between fill soils and apparently similar natural soils in the absence of foreign matter. The possible fill fat clay (CL) soils of stratum I are expansive with a plasticity index (PI) of about 37. The possible fill lean clay (CL) of stratum II are moderately expansive with plasticity indices (PI's) ranging from 28 to 29. The natural lean clay (Cl) of stratum III are moderately expansive with plasticity indices (PI's) ranging from 20 to 29. These moderately expansive (PI >20) lean clay (CL) soils and expansive fat clay (CH) soils are expected to undergo a moderate to high shrink/swell potential with changes in moisture contents. These moderately expansive lean clay (CL) and expansive fat clay (CH) soils are not suitable for use as select fill in their present condition. These soils once lime stabilized using 5% and 6 % lime by dry weight, respectively, should be suitable for use as select fill. However, these soils in their present condition (and free of any debris, organics or other deleterious materials) should be suitable for use as random fill material.

A more detailed stratigraphy is presented on log of borings B-1 through B-5 (Plates 2 through 6). Definition of terms and key to symbols used in the boring log is presented on Plate 7.

### 7.0 GROUNDWATER INFORMATION

The soil borings were dry augered to observe the presence of any perched water or ground water. The levels where perched or groundwater were encountered in the borings are shown on the respective boring logs. Groundwater was encountered in the borings at the time of drilling at depths below 15 feet.

It should also be noted that fluctuations in groundwater levels generally occur as a function of seasonal rainfall variations, groundwater removal, temperatures, topography, surface and subdrainage features around the site.

It should also be noted that a detailed hydrogeological investigation of the proposed project area is beyond the scope of this investigation. An accurate evaluation of the groundwater in the low permeability clays and silt require long term observations in monitoring wells or piezometers. Their installation was not in our scope of work. Groundwater levels should be verified prior to starting any excavations that may be affected by it such as utilities, drilled piers, etc. TGC should be contacted if any significant change is observed in the groundwater then that mentioned in this report. We can then evaluate the effect of any groundwater changes on the design or construction recommendations given in this report.

## 8.0 POTENTIAL VERTICAL RISE

The upper stratum of soil at this site consists of moderately expansive lean clays and expansive fat clays (CH). These lean clay (CL) soils have a moderate potential for expansion and shrinkage with changes in moisture contents. The fat clay (CH) soils have a high potential for expansion and shrinkage with increases and decreases in moisture content. When these moderately expansive lean clay (CL) and expansive fat clay (CH) soils receive an increase in its moisture content, they swell or expand. When these soils dry up resulting in a decrease in its moisture content, they settle or shrink. This swelling or shrinking of these soils with changes in its moisture content will affect any building foundation placed on it. There are several methods used to calculate the potential vertical rise (PVR), which is the total amount that the soil is expected to swell or shrink. These methods have different assumptions. Some assume a linear change in moisture content with depth, assuming higher moisture changes at the top and lower moisture changes at deeper depths. Some methods are more conservative and assume constant moisture change throughout the active zone of soil. Here the active zone of soil is defined as the depth of soils up to which changes in moisture content is expected.

In most normal cases, a linear variation of moisture with depth is an appropriate assumption. However, in cases where very negative drainage will result in ponding of water adjoining the foundation at the site or for cases where there is a water leak, the more conservative assumption of constant change in moisture with depth would be more appropriate.

The test method known as TEX-124-E assumes a constant variation in moisture with depth, i.e it assumes that the soils down to the active zone gets saturated. The TEX-124-E method is generally preferred by designers in the area as it may offset risks associated with future unknowns with site drainage or pipe conditions.

Based on Test Method TEX-124-E by the Texas State Department of Highways and Public Transportation, Materials and Tests Division, the soil conditions at this site has a potential vertical rise (PVR) of about 1.3- to 1.5 inches.

The methods generally adopted to reduce the PVR of the soils typically consists of undercutting and replacement of surficial expansive soils with low plasticity fill materials or adding fill surcharge to the existing soils. Under buildings, the fill materials should consist of low plasticity select fill soils identified as lean clay (CL) and having plasticity indices (PI's) ranging from 10 to 20. The ability to use surcharge soils on top of existing soils will be controlled by the final grade of the building slab. A combination of cut and fill method may be used to determine the select fill thickness to reduce the PVR. Based on our calculations, the following measures will reduce the PVR at the site as shown in the Table 2 below.

**Table 2- Potential Vertical Rise (PVR) for different options.**

Option	PVR (inches)
Existing condition	1.3 to 1.5
Remove 2 feet and add 2 feet of select fill	0.8 to 1.0

## 9.0 FOUNDATION RECOMMENDATIONS

Foundations for the structures should satisfy three separate design requirements as mentioned here.

1) The maximum foundation loads should not exceed the allowable bearing pressures given in the report. 2) The total and differential settlements under sustained loads should not exceed the settlement tolerance limit of the structure. 3) The total and differential heaving should not exceed the movement tolerance limit of the structure.

The foundation for the proposed building may consist of a floor slab supported on drilled piers or a floating slab foundation supported at grade. The canopy will be supported on piers. Our recommendations for these foundation types are given below.

### 9.1 DRILLED PIERS

Drilled piers with underreams (bell) may be used for the building and canopy foundation. Drilled piers founded at the depths of 11 feet may be designed for an allowable bearing pressure of 3000 psf for dead plus sustained live loads and 4500 psf for total loads. The given values include a factor of safety of 3 and 2, respectively.

An underream to shaft ratio of 3 to 1 may be used for the drilled piers. Seams, pockets or layers of silt or sands or the presence of slickensides in the clay stratum may cause the underream to slough. In the event of underream sloughing, the ratio should be reduced to 2 to 1 by increasing the shaft diameter. If sloughing still continues then straight sided shafts may have to be used. In this event the diameter of the straight shaft must be made equal to the diameter of the designed underream to obtain the same compressive capacity.

Based on the groundwater readings, groundwater is not likely to be encountered during shallow drilled pier excavations. However, it should be noted that fluctuations in groundwater level occurs as a result of seasonal rainfall variations, temperature, drainage changes, etc. In the event that groundwater is encountered, all standing water in the drilled pier excavations should be pumped out and the drilled pier concrete poured as soon as possible after the completion of the excavation. A casing or slurry method may be required for drilled pier installations below the groundwater depth.

The drilled piers may be subjected to uplift forces due to shrink/swell of the surrounding soils. An adhesion value of 0.5 tsf should be applied to the straight sided portion of the drilled piers in clay soils (top 8 ft) for computations of uplift loads. The calculated uplift force may be used to calculate the reinforcements required for resisting the uplift force due to swelling soils. At a minimum, the cross sectional area of reinforcing steel should not be less than 0.5% of the gross cross sectional area of the drilled pier. The reinforcement should extend the full depth of the pier.

The uplift capacity of drilled and underreamed piers may be taken as:

$$Q_u = 0.785 * N_u * C * (D^2 - d^2)$$

Here:  $Q_u$  = Ultimate Uplift Capacity in tons (or kips or pounds)

$N_u$  = Dimensionless factor =  $3.5 * (H/D) \leq 9$

$C$  = Undrained cohesion in tsf (or ksf or psf) – use 0.5 tsf for design purposes

$D$  = Diameter of underream, feet

$d$  = Diameter of shaft, feet

$H$  = Depth of pier, feet

A factor of safety of 2.0 for transient and wind loads and 3.0 for sustained loads is recommended for the uplift capacity.

The lateral capacity of drilled piers may be calculated using passive resistance of soils. An allowable passive resistance of 1000 psf in clay soils may be taken for design purposes. The passive resistance in the top 2 feet should be neglected for design purposes. The lateral capacity may also be analyzed using computer programs such as LPILE Plus. A horizontal modulus of subgrade reaction,  $k$ , of 300 pci may be taken in natural clay soils for design purposes.

The minimum clear spacing of 3 underream diameters center to center is recommended. If the spacing between the two underreams is less than 3, then stress concentrations will occur between the two piers. Use of lower allowable bearing pressures may be required. TGC should be contacted if the spacing is significantly closer from that recommended above.

#### 9.1.1 Floor Slabs Supported on Drilled Piers

The building floor slabs used in conjunction with drilled piers may consist of either structurally supported slab with 4 inch void space or slab on grade supported on suitable thickness of select fill soils.

The structurally supported slab should be suspended above grade with a void space greater than the anticipated heave of the underlying soils. A minimum void space of 6 inches should be used for this site. The void space should have positive drainage to prevent water accumulation in that space.

Floor slabs supported at grade may be used provided a minimum compacted thickness of select fill is used so as to reduce the total PVR to less than the acceptable limit for the structural design. Table 2 in the "PVR" section shows the fill thickness versus the corresponding PVR values. A minimum select fill thickness of 2 feet is recommended under the floor slabs for this option. Positive drainage must be developed and maintained all around the building at all times.

## 9.2 FLOATING SLAB FOUNDATION

A floating slab foundation at this site may be an engineered post-tensioned slab (Ref. 1) or ribbed & reinforced (conventionally reinforced) slab (Ref. 2) with a perimeter footing and interior thickened sections. The fill soils (wherever and whatever depth encountered) must be excavated, reprocessed and recompactd (or replaced with select fill) in accordance with the "site preparation" section of this report.

Minimum Grade Beam Depth Below Final Grade: 12 inches

Grade Beam Allowable Bearing Pressure (in stiff compacted stiff soils)

Total Loads	:	2250 psf		
Dead + Sustained Live Loads	:	1500 psf		
Atterberg Limits	:	LL=48;	PL=20;	PI=28
Thornwaite Moisture Index	:	Im =	18	
Constant Suction Value	:	PF =	3.45	
Edge Moisture Variation	:	em =	9.0	ft.(Center lift)
	:	em =	5.7	ft. (Edge lift)
Estimated Differential Swell	:	Ym =	1.1	inch (Center lift)
	:	Ym =	0.9	inch (Edge lift)
Support Index	:	C =	0.75	

## 9.3 FOUNDATION SETTLEMENT

A detailed settlement analysis was not within the scope of our work. It is anticipated that foundations designed based on the allowable bearing pressures and other recommendations as given in this report will experience settlements which should be within the allowable limits of the proposed structure.

## 10.0 PAVEMENT

### 10.1 GENERAL

We understand that the pavement for parking areas and drives will consist of concrete or asphalt paving. The traffic likely to use the pavement will generally consist of light automobile vehicles and medium trucks. The heaviest vehicle will consist of a daily garbage truck. The paving will be supported on existing soils. The top 6 inches of onsite soils under the paving should be lime stabilized using 6% lime by dry weight. This will result in an application rate of 28 pounds per square yard for each 6 inches of compacted stabilized soil thickness. A more accurate percentage may be determined at the time of construction using lime series tests.

For the purpose of recommendations given below the light, medium and heavy vehicles should be considered based on the following weights.

Light Vehicle	up to 5,000 lbs
Medium Vehicle	5,000 lbs to 20,000 lbs
Heavy Vehicle	greater than 20,000 lbs

The concrete and asphalt paving section thickness are given below.

### 10.2 CONCRETE PAVEMENT

The concrete paving thickness for the different paving areas may be taken as given below.

<u>Paving Area</u>	<u>Paving Thickness</u>
Light and Medium Vehicle Parking	5 inches
Light and Medium Vehicle Drives	6 inches
Heavy Vehicle Drive	7 inches
Very Heavy Vehicle Drive (large trucks)	8 inches

The concrete for the garbage dumpster pad where the garbage trucks stops and moves back and forth should be 7 inches thick. The top 6 inches must be lime stabilized as given in section 10.1. The lime stabilization may be as per TxDOT Standard Item 260.

The 5 inch thick concrete pavement may be reinforced using No.4 bars spaced at 24 inches center in both directions. The 6, 7- and 8 inch thick concrete pavement may be reinforced using No. 4 bars spaced at 18 inches, 15 inches and 12 inches center, respectively, in both directions. Other suitable thicknesses and spacing acceptable to the designer may also be used.

### 10.3 ASPHALT PAVEMENT

The asphalt paving section thickness for the different parking areas may be taken as given below.

<u>Paving Area</u>	<u>HMAC</u>	<u>Base</u>	<u>Stabilized Subbase</u>
Light and Medium Vehicle Parking	2 inch	6 inch	6 inch
Light and Medium Vehicle Drives	2 inch	8 inch	6 inch
Heavy Vehicle Drive	3 inch	8 inch	8 inch
Very Heavy Vehicle Drive	Use Concrete Section		

The garbage dumpster pad where the garbage trucks stops and moves back and forth should be of concrete as given in section 10.2. The subbase/subgrade soils must be stabilized as given in section 10.1.

The base may consist of crushed limestone, gravel or crushed concrete. The HMAC should consist of TXDOT Type D, Standard Item 340.

### 11.0 SITE PREPARATION

The following system of construction procedures is recommended:

1. In general remove all surface organics, organic topsoil, roots, existing foundations and paving and all unsuitable materials from all structure and paving areas.
2. Proof roll the subgrade with a loaded dump truck, scraper or similar pneumatic-tired equipment to detect any wet, soft, or pumping areas. Soils deflecting excessively during proofrolling should be undercut to firm soils and recompacted. Treat the wet or pumping soils with drying or stabilizing agents as necessary or remove and replace them with a suitable fill material. Any existing fill material should have records of passing densities for all lifts or should be excavated, reprocessed and recompacted as below.
3. Scarify the subgrade, add moisture or dry as necessary and compact the subgrade to a minimum of ninety-five (95) percent of its maximum dry density as determined by the Standard Proctor Compaction Test (ASTM D 698). The moisture content should be plus or minus 2 percent of the optimum moisture.
4. Structural fill material within the structure area should be a lean clay (CL) having a plasticity index (P.I.) of ten (10) to twenty (20) and a liquid limit of 25 or more. Fill materials should be placed in six (6) to eight (8) inch loose lifts and compacted at plus or minus 2 percent of optimum moisture content to ninety-five (95) percent of their maximum dry density as determined by the Standard Proctor Compaction Test.
5. Establish positive site drainage. Install storm drainage structures if required.
6. The backfill soils in the utility trenches may consist of select fill mentioned in Item 4. In the event of compaction difficulties, cement sand may be used as backfill material. Due to the high permeability and potential for surface water intrusion from these soils to under the building slab, bank sand should not be used as backfill material for the utility trenches under the building and minimum 5 feet outside the building area.

7. The subgrade and fill moisture content and density must be maintained until the placement of floor slabs or pavement. Verification of this should be done prior to slab or pavement placement. Scheduling of the building slab pour as soon as possible after the subgrade and fill compaction would help in minimizing moisture and density changes due to drying, wetting or disturbance of these soils.

## 12.0 VEGETATION CONTROL

### 12.1 Existing Trees

Existing trees roots absorb moisture from their surrounding soils. This results in formation of pockets of isolated dry soils around the tree roots with a moisture content significantly lower than the soil moisture contents away from these roots. When the trees are cut, the roots die and stop absorbing moisture from their surrounding soils. With time and seasonal rainfall as well as by capillary action, these dry pockets of soils will undergo increases in moisture content and as a result heave. If the tree is cut and a building or paving is immediately constructed on it, then these isolated areas of dry soils will heave more than the soils at other areas of the building/paving or site. This will result in differential heaving under the structure or pavement. Where large trees are cut and building built over it, the slab should be stiffened to resist the higher differential heave. Alternatively, a safer option would be to structurally support the building slab on deeper footings with a void space larger than the anticipated maximum heave of the drier soils. Positive drainage should be developed and maintained all around the building at all times.

### 12.2 New Trees

New trees should be avoided near the building slab especially larger trees. No tree should be planted closer than 20 feet or half the canopy diameter of fully matured trees. Alternatively, root barriers may be used to prevent the migration of tree roots underneath the buildings. Use of large shrubs should be avoided immediately adjacent to the building slab.

### 13.0 SITE DRAINAGE

Final site drainage is very critical for long term performance of the proposed structure and pavement.

1. In general, set top of concrete at least eight inches above final adjacent soil grade for damp proofing.
2. Provide adequate drainage away from foundations (minimum ten percent slope in the first five feet). The bottom of any drainage swale should not be located within four feet of the foundations. Pervious planting beds should slope away from the foundations at least two inches per foot. Planting bed edging shall allow water to drain out of the beds. Water must not be allowed to pond anywhere close to the building or pavement.
3. Gutters or extended roof eaves may be used, especially under all roofs valleys. All extended eaves or gutter down spouts should extend at least two feet away from the foundations and past any adjacent planting beds. Roof drains should preferably discharge to storm sewers by closed pipe or extended away from the structures by 5 feet or as far as possible.
4. Any plumbing leaks must be repaired immediately.
5. Sprinkler systems if used should be used all around the building to provide a uniform water application system. Sprinkler systems should be located a minimum of five feet from the building edge.
6. Moisture conditions should be maintained "constant" around the edge of the building or pavement. Ponding of water or excessive drying should not be allowed in planter beds or anywhere adjacent to the building or pavement edge.
7. Large trees and shrubs should not be planted closer than 20 feet or half the canopy diameter of mature trees or shrubs.

#### 14.0 CONSTRUCTION OBSERVATIONS

Texas Geotechnical Consultants, LLC. (TGC) recommends implementation of a comprehensive quality control program under the supervision of a Professional Engineer. Structural integrity and stability is particularly dependent on quality foundation installation.

Construction inspection and quality control tests should be planned to verify materials and placement with accordance with the specifications. TGC should be retained to review the foundation drawings and specifications to verify that the recommendations outlined in this report have been properly interpreted and implemented. Proofrolling, subgrade compaction, fill placement, drilled footing construction and concrete strength should be monitored.

#### 15.0 LIMITATIONS OF STUDY


The analysis and recommendations submitted in this report are based upon the data obtained from the five (5) borings drilled at the site. Soil conditions may vary across the site. If significant variations are noted during construction, TGC should be contacted to evaluate the effect of these variations on the recommendations given in this report.

TGC states that the findings, recommendations or professional opinions or advice contained in this report (and that may be given henceforth in connection with this project) have been made and this report prepared in general accordance with generally accepted professional engineering practice in the field of geotechnical engineering as based on the location, size and type of project. No other warranties, either written or verbal, are implied or expressed.

This report has been prepared for the exclusive use of the owner, the project architect, the project structural engineer and contractors for the specific application to the proposed Ivy Kids on County Road 94 near County Road 101 in Manvel, Texas.

## 16.0 REFERENCES

1. "Design and Construction of a Post-Tensioned Slab-On-Ground", 3<sup>rd</sup> Edition, Post-Tensioning Institute, Phoenix, Arizona, 2004 (with 2008 supplement).
2. Snowden, Walter L (1981), Design of Slab-On-Ground Foundation, Snowden, Inc., Austin, Texas.
3. Joseph E. Bowles (1982), Foundation Analysis and Design, 3rd ed., McGraw-Hill Book Company.

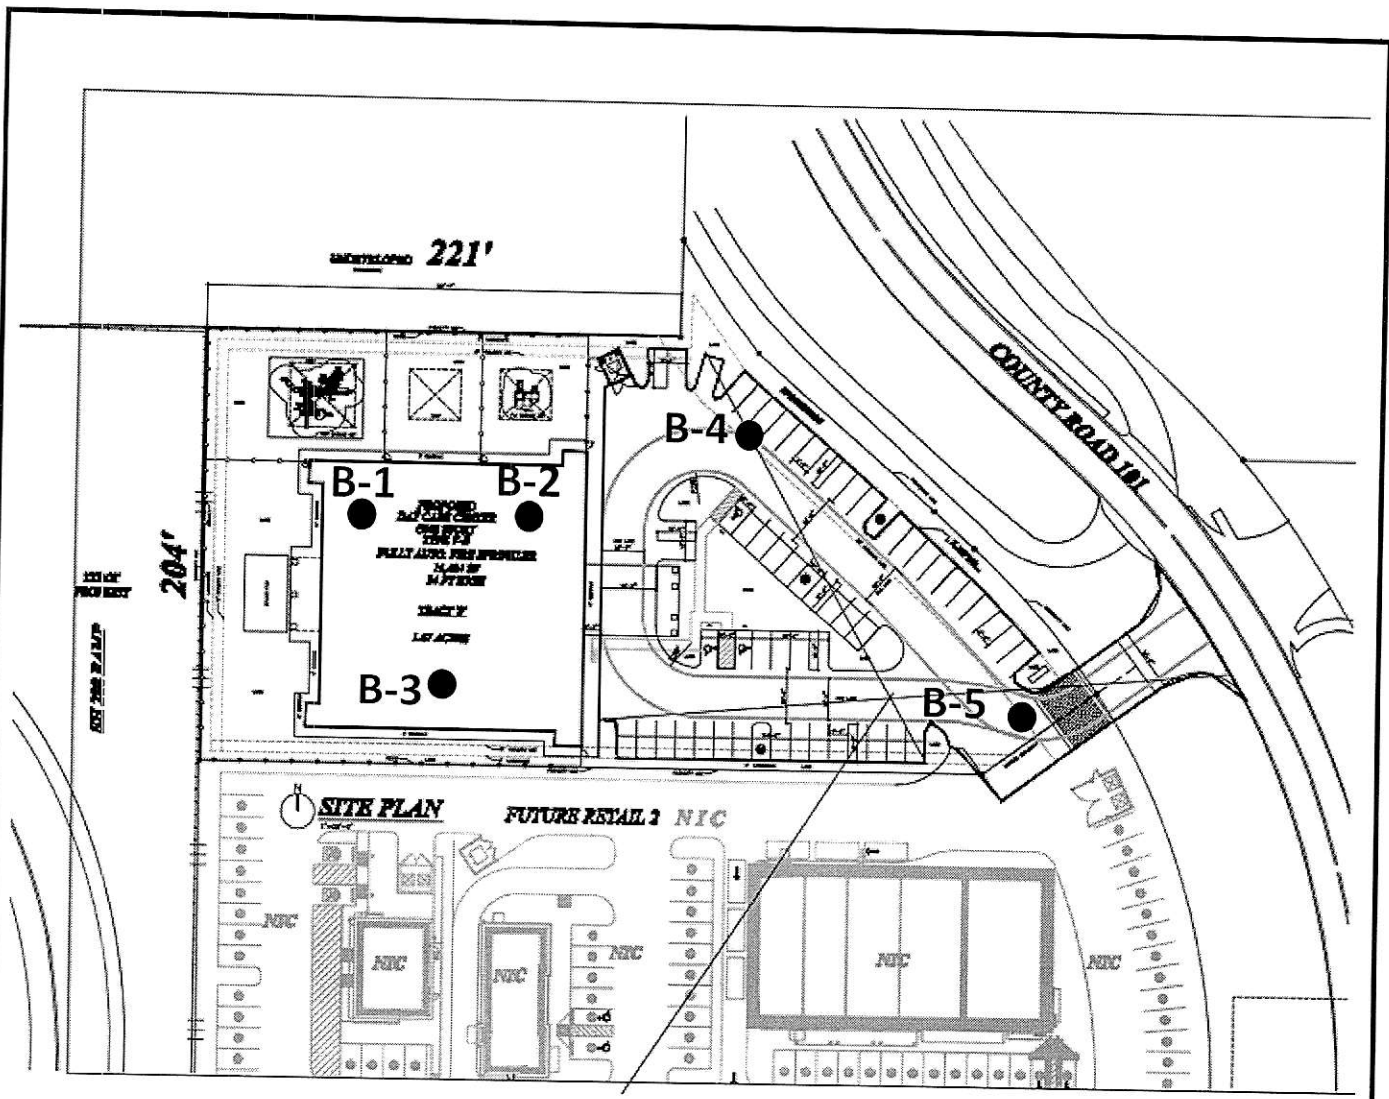

Note: Boring Locations shown are Approximate.

Project Name: Proposed Ivy Kids on C.R 94 and C.R 101, Manvel, Texas

TGC Report No. 807231

Date: 7-25-2018

Scale: Not to Scale

BORING  
LOCATION  
PLAN

**TEXAS GEOTECHNICAL CONSULTANTS, LLC.**

**LOG OF BORING B-1**

<b>Project:</b>	Proposed Ivy Kids On County Road 94 near County Road 101 Manvel, Texas	<b>Date:</b> 7/25/2018
<b>Client:</b>	Lone Star Academics and Childcare, LLC	<b>Job Number:</b> 807231
		<b>Boring Method:</b> Dry Auger
		<b>Elevation:</b> Existing
		<b>Driller:</b> DLT Drilling

FIELD DATA				LABORATORY DATA							
------------	--	--	--	-----------------	--	--	--	--	--	--	--

Depth (Feet)	Samples	Soil Types	SPT (Blows Per Feet)	SOIL DESCRIPTION	Moisture Content, %	Plasticity Index	Liquid Limit	UC Shear Strength, tsf	TV Shear Strength, tsf	Hand Penetrometer, tsf	200 Sieve, %	Unit Dry Weight, pcf		
1	[Shaded]	CL		Possible Fill: Lean Clay (CL), hard, dark gray and brown, with calcareous nodules, sand pockets and root organics	15	28	48		2.5	4.5				
2														
3						dark gray, brown and reddish brown below 2 feet	15				2.5	4.5		
4														
5	[Shaded]	CL		Lean Clay (CL), stiff, tan and brown, with ferrous and calcareous nodules	19	27	47		1.2	2.3				
6														
7							17				0.8	1.5		
8														
9							19	23	40	0.7	1	2		111
10														
11														
12														
13														
14	[X]	SM	12	Silty Sand (SM), medium dense, tan and brown, with clay pockets, moist	30									
15														
16						wet below 15 feet								
17														
18														
19	[X]		15		28									
20														
Boring terminated at 20 feet														

<b>REMARKS:</b> UC Shear Strength = Unconfined Compression Shear Strength TV Shear Strength = Torvane Shear Strength	<b>GROUNDWATER:</b> 15 feet
	<b>Hole Caved:</b> PLATE 2

**TEXAS GEOTECHNICAL CONSULTANTS, LLC.**

**LOG OF BORING B-2**

<b>Project:</b>	Proposed Ivy Kids On County Road 94 near County Road 101 Manvel, Texas	<b>Date:</b> 7/25/2018
<b>Client:</b>	Lone Star Academics and Childcare, LLC	<b>Job Number:</b> 807231
		<b>Boring Method:</b> Dry Auger
		<b>Elevation:</b> Existing
		<b>Driller:</b> DLT Drilling

FIELD DATA				LABORATORY DATA							
------------	--	--	--	-----------------	--	--	--	--	--	--	--

Depth (Feet)	Samples	Soil Types	SPT (Blows Per Feet)	SOIL DESCRIPTION	Moisture Content, %	Plasticity Index	Liquid Limit	UC Shear Strength, tsf	TV Shear Strength, tsf	Hand Penetrometer, tsf	200 Sieve, %	Unit Dry Weight, pcf
1		CL		Possible Fill: Lean Clay (CL), hard, dark gray and brown, with calcareous nodules, sand pockets and root organics	22				2.5	4.5		
2												
3				dark gray, brown and reddish brown, with ferrous nodules below 2 feet	15	28	48		2.5	4.5		
4												
5		CL		Lean Clay (CL), stiff, gray, tan and brown, with ferrous and calcareous nodules	17			0.8	1.8	2.8		112
6												
7				tan and brown below 6 feet	20	23	37		0.8	1.5		
8												
9					21				1	1.8		
10												
11												
12												
13												
14	X	SM		Silty Sand (SM), medium dense, tan and brown, with clay pockets, moist	28						39	
15	X		13	wet below 15 feet								
16												
17												
18												
19	X				27							
20	X		14									
				Boring terminated at 20 feet								

**REMARKS:**  
 UC Shear Strength = Unconfined Compression Shear Strength  
 TV Shear Strength = Torvane Shear Strength

**GROUNDWATER:** 15 feet

**Hole Caved:** PLATE 3

**TEXAS GEOTECHNICAL CONSULTANTS, LLC.**

**LOG OF BORING B-3**

<b>Project:</b>	Proposed Ivy Kids On County Road 94 near County Road 101 Manvel, Texas	<b>Date:</b> 7/25/2018
<b>Client:</b>	Lone Star Academics and Childcare, LLC	<b>Job Number:</b> 807231
		<b>Boring Method:</b> Dry Auger
		<b>Elevation:</b> Existing
		<b>Driller:</b> DLT Drilling

FIELD DATA				LABORATORY DATA							
------------	--	--	--	-----------------	--	--	--	--	--	--	--

Depth (Feet)	Samples	Soil Types	SPT (Blows Per Feet)	SOIL DESCRIPTION	Moisture Content, %	Plasticity Index	Liquid Limit	UC Shear Strength, tsf	TV Shear Strength, tsf	Hand Penetrometer, tsf	200 Sieve, %	Unit Dry Weight, pcf
1		CH		Possible Fill: Fat Clay (CH), hard, dark gray and brown, with calcareous nodules, sand pockets and root organics	15	37	57		2.5	4.5		
2												
3		CL		Possible Fill: Lean Clay (CL), hard, dark gray and brown, with calcareous nodules	13				2.5	4.5		
4												
5		CL		Lean Clay (CL), hard, tan and brown, with ferrous and calcareous nodules	14	20	36		2.5	4.5		
6				stiff below 6 feet								
7					19				1	2		
8												
9					22	22	38	0.5	0.8	1.5		109
10												
11												
12												
13												
14	X	SM		Silty Sand (SM), medium dense, tan and brown, with clay pockets, moist	26							
15	X		15	wet below 15 feet								
16												
17												
18												
19	X											
20	X		15		31							
				Boring terminated at 20 feet								

<b>REMARKS:</b> UC Shear Strength = Unconfined Compression Shear Strength TV Shear Strength = Torvane Shear Strength	<b>GROUNDWATER:</b> 15 feet
	<b>Hole Caved:</b> PLATE 4





TERMS USED ON BORING LOGS

SOIL GRAIN SIZE  
U.S.STANDARD SIEVE

6"	3"	¾"	#4	#10	#40	#200		
BOULDER	COBBLES	GRAVEL		SAND			SILT	CLAY
		COARSE	FINE	COARSE	MEDIUM	FINE		
152	76.2	19.1	4.76	1.00	0.420	0.074	0.002	

SOIL GRAIN SIZE IN MILLIMETERS

STRENGTH OF COHESIVE SOILS

RELATIVE DENSITY OF COHESIONLESS SOILS  
(From Standard Penetration Tests)

Consistency                      Undrained  
    Shear Strength,  
    Kips Per Sq. ft

Very Soft..... less than 0.25  
Soft..... 0.25 to 0.50  
Firm..... 0.50 to 1.00  
Stiff..... 1.00 to 2.00  
Very Stiff..... 2.00 to 4.00  
Hard..... greater than 4.00

Very Loose                      < 4 bpf  
Loose                              5-10 bpf  
Medium Dense                      11-30 bpf  
Dense                              31-50 bpf  
Very Dense                      >50 bpf  
(bpf= blow per foot, ASTM D 1586)

SPLIT BARREL SAMPLER DRIVING RECORD

Blows per Foot

Description

25..... 25 blows driving sampler 12 inches after initial 6 inches of seating.  
50/7"..... 50 blows driving sampler 7 inches after initial 6 inches of seating.  
50/3"..... 50 blows driving sampler 3 inches after initial 6 inches of seating.

Note: To avoid damage to sampling tool, driving is limited to 50 blows during or after seating interval.

DRY STRENGTH                      ASTM D2488

MOISTURE CONDITION  
ASTM D2488

None    Dry Specimen crumbles into powder with mere pressure of handling  
Low    Dry Specimen crumbles into powder with some finger pressure  
Medium    Dry Specimen breaks into pieces or crumbles with considerable pressure  
High    Dry Specimen cannot be broken with finger pressure, can be broken between  
            Thumb and hard surface  
Very High    Dry Specimen cannot be broken between the thumb and hard surface

Dry    Absence of Moisture  
Moist    Damp but no visible water  
Wet    Visible free water

SOIL STRUCTURE

Slickensided    Having planes of weakness that appear slick and glossy. The degree of slickensidedness depends upon the spacing of slickensides and the easiness of breaking along these planes.  
Fissured    Containing shrinkage or relief cracks, often filled with fine sand or silt usually more or less vertical  
Pocket    Inclusion of material of different texture that is smaller than the diameter of the sample  
Paring    Inclusion of less than 1/8 inch thick extending through the sample  
Seam    Inclusion of 1/8 inch to 3 inches thick extending through the sample  
Layer    Inclusion of greater than 3 inches thick extending through the sample  
Laminated    Soil sample composed of alternating partings or seams of different soil types  
Calcareous    Having appreciable quantities of calcium material  
Ferrous    Having appreciable quantities of ferrous or iron nodules